




Installation contrôlée par :
 Installatie gecontroleerd door:
 Avenue Eiffel, 8 - 1300 Wavre - 010/280 577
 Inspecteur: KOLUKISA OGLU Alein
 Date: Datum: 22/07/20
 Signature: Handtekening:

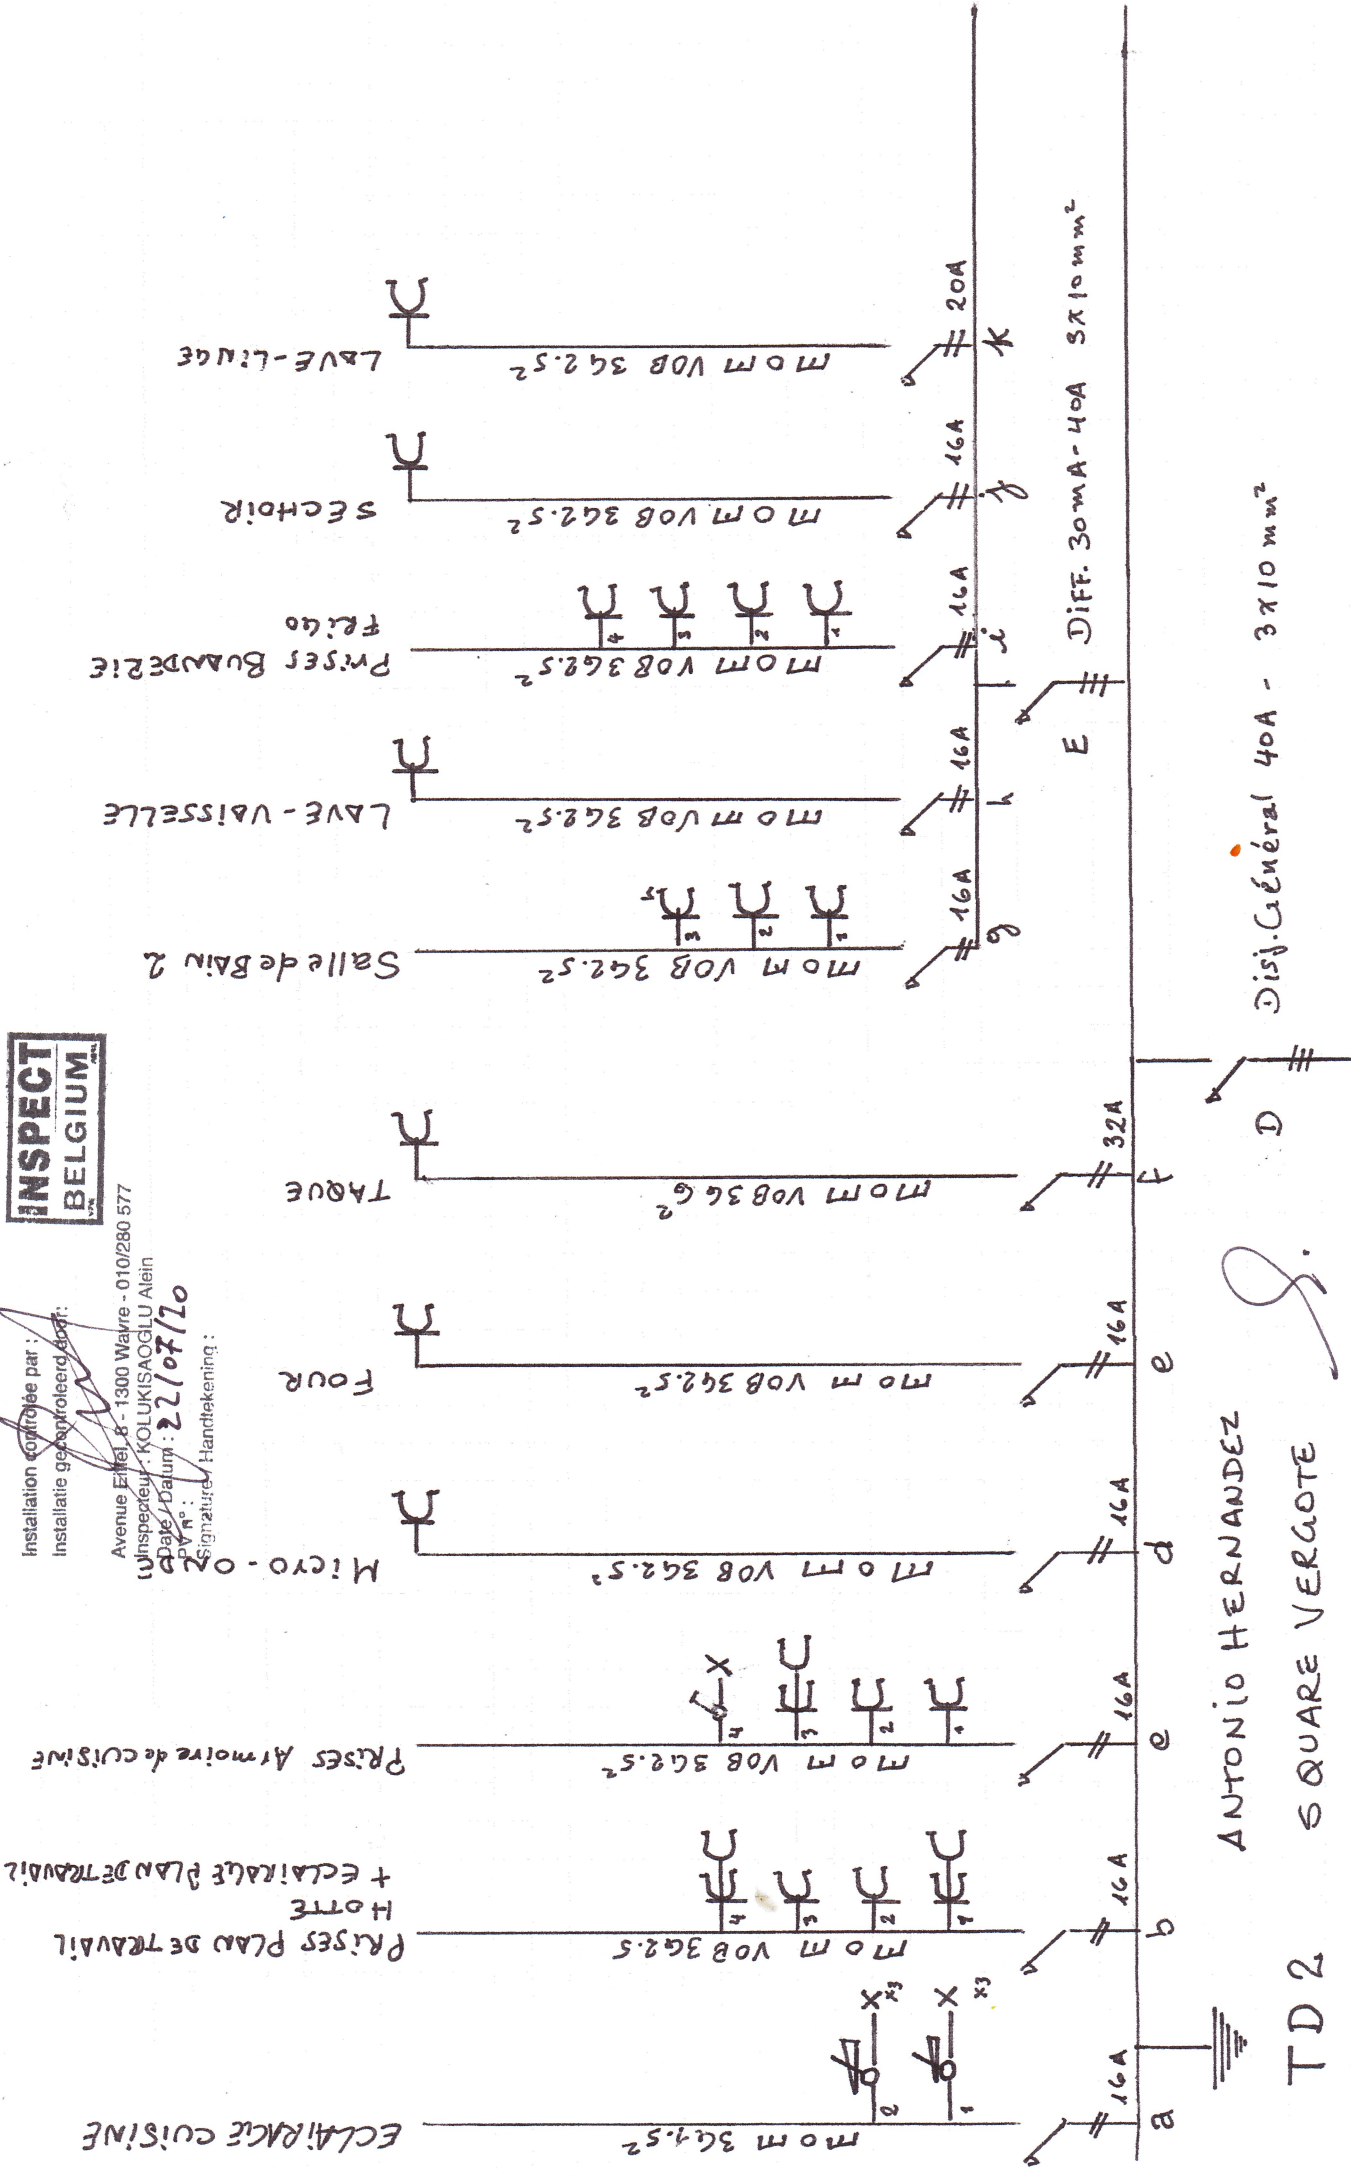

ANTONIO HERNANDEZ
 S. S. S. S.

TD2
 SQUARE VERGOTE
 1200 - W.S.L

Disj. Général 40A - 3x10mm²

DIFF. 300mA-40A 3x10mm²